




## T48/P48/TLA OUTPUT BOARD

### INSTALLING AN OUTPUT BOARD

*Caution: The bezel assembly contains electronic circuits that can be damaged by static electricity. Before removing the assembly, discharge static charge on your body by touching an earth ground point. It is also important that the bezel assembly be handled only by the bezel itself. When handling a circuit board, be certain that hands are free from dirt, oil, etc., to avoid circuit contamination that may lead to a malfunction.*

1. Remove the controller from the case.
2. Lift up on the top bezel board latch while gently pulling out on the bezel/display board assembly. Do NOT remove the display board from the bezel.
3. Remove the output board by pulling it away from the other boards. Replace the output board by aligning the board to board connector. Be certain the connector is fully mated.
4. Connect the bezel/display board assembly by guiding the board ends into the bezel latches. Slide the assembly on evenly until the display board connector is completely engaged and bezel latches are fully seated onto the boards.

*Note: When replacing the output board, be certain to install a new output board of the same type. Appropriate rewiring considerations must be given if the output board type is changed.*

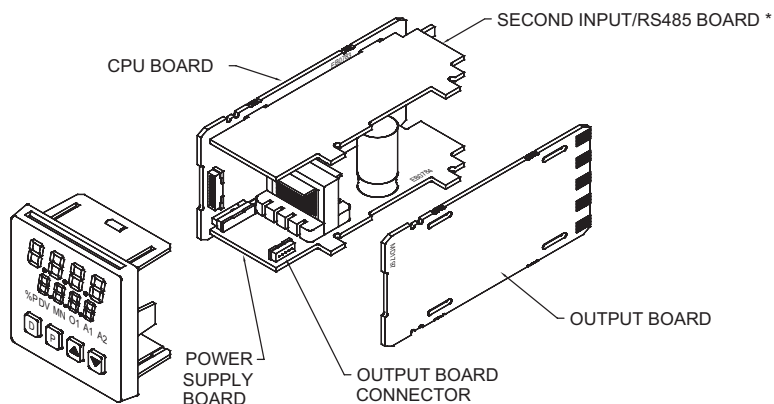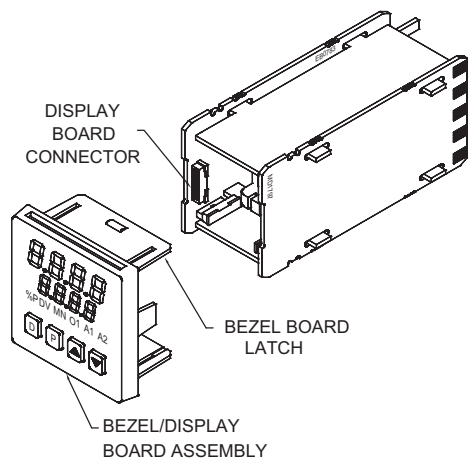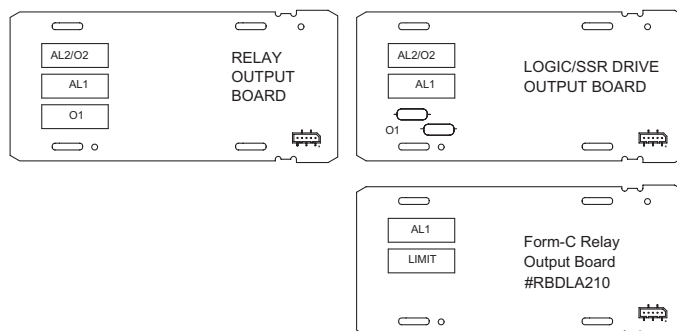

\* MODEL NUMBER DEPENDENT

### SPECIFICATIONS & TYPICAL CONNECTIONS

#### Relay Connections

##### RBD48 Relay Outputs:

- Type: Form-A (Shared common for the Alarms)
- Contact Rating: 3 A @ 250 VAC or 30 VDC (resistive load)


##### RBDLA Relay Outputs:

- Limit Relay Type: Form-C
- Alarm 1 Relay Type: Form-A
- Contact Rating: 5 A @ 250 VAC or 30 VDC (resistive load)
- Life Expectancy: 100,000 cycles at max. load rating. (Decreasing load and/or increasing cycle time, increases life expectancy.)


To prolong contact life and suppress electrical noise interference due to the switching of inductive loads, it is good installation practice to install a snubber across the contactor. Follow the manufacturer's instructions for installation.

*Note: Snubber leakage current can cause some electromechanical devices to be held ON.*

Main Control Output

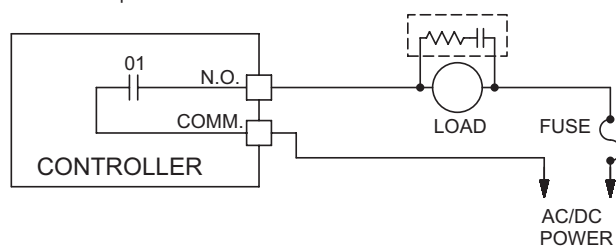

Alarm Outputs/Cooling

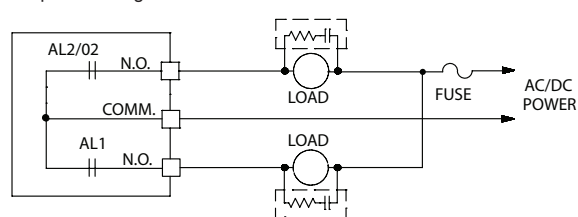


**Logic/SSR Connections (T48 Only)**

**Logic/SSR Drive Output (O1 only):**

**Rating:** 45 mA @ 4 V min., 7 V nominal (current limited)

Main Control Output

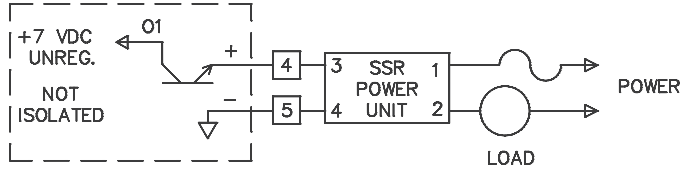

**ORDERING INFORMATION**

MODEL NO.	MAIN CONTROL OUTPUT	AL1	AL2 02 (COOL)	PART NUMBER
RBD48	RLY-A	NONE	NONE	RBD48100
	RLY-A	RLY-A	RLY-A	RBD48111
	LGC	NONE	NONE	RBD48200
RBDLA	LGC	RLY-A	RLY-A	RBD48211
	RLY-C	RLY-A	NONE	RBDLA210



Do not dispose of unit in trash - Recycle

*Note: For units equipped with a single alarm, order a dual alarm replacement board.*

*Note: RLY-A = Form-A Relay Output*

*RLY-C = Form-C Relay Output*

*LGC= Logic/SSR Drive Output*

**LIMITED WARRANTY**

The Company warrants the products it manufactures against defects in materials and workmanship for a period limited to two years from the date of shipment, provided the products have been stored, handled, installed, and used under proper conditions. The Company's liability under this limited warranty shall extend only to the repair or replacement of a defective product, at The Company's option. The Company disclaims all liability for any affirmation, promise or representation with respect to the products.

The customer agrees to hold Red Lion Controls harmless from, defend, and indemnify RLC against damages, claims, and expenses arising out of subsequent sales of RLC products or products containing components manufactured by RLC and based upon personal injuries, deaths, property damage, lost profits, and other matters which Buyer, its employees, or sub-contractors are or may be to any extent liable, including without limitation penalties imposed by the Consumer Product Safety Act (P.L. 92-573) and liability imposed upon any person pursuant to the Magnuson-Moss Warranty Act (P.L. 93-637), as now in effect or as amended hereafter.

No warranties expressed or implied are created with respect to The Company's products except those expressly contained herein. The Customer acknowledges the disclaimers and limitations contained herein and relies on no other warranties or affirmations.

Red Lion Controls  
Headquarters  
20 Willow Springs Circle  
York PA 17406  
Tel +1 (717) 767-6511  
Fax +1 (717) 764-0839

Red Lion Controls  
Europe  
Softwareweg 9  
NL - 3821 BN Amersfoort  
Tel +31 (0) 334 723 225  
Fax +31 (0) 334 893 793

Red Lion Controls  
India  
201-B, 2nd Floor, Park Centra  
Opp 32 Mile Stone, Sector-30  
Gurgaon-122002 Haryana, India  
Tel +91 984 487 0503

Red Lion Controls  
China  
Unit 302, XinAn Plaza  
Building 13, No.99 Tianzhou Road  
ShangHai, P.R. China 200223  
Tel +86 21 6113 3688  
Fax +86 21 6113 3683